

► **Code Number:**

0345154PK

► **Description**

Box-Mount Transformer designed for use with Sloan Optima® and PWT® Systems.




► **Specifications**

- 120 VAC Input, 50/60 Hz Primary
- 24 VAC Output, 50/60 Hz Secondary
- Class II, UL Listed
- 50 VA
- A maximum of ten (10) Flushometer units can operate from one (1) Sloan EL-154 Transformer, Class 2, UL Listed, 50 VA (min.) at 24 VAC, plate mounted.

► **NOTE:**

One Sloan EL-154 transformer can operate up to ten OPTIMA® equipped Flushometers. Run 18-gauge wire from transformer to Flushometer(s). Wire supplied by others. DO NOT supply power to transformer until installation of Flushometer is complete.

Also recommended for use on combination units or a maximum of three lavatory or three shower solenoid valves.

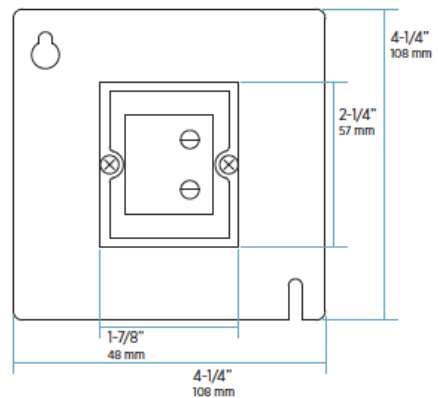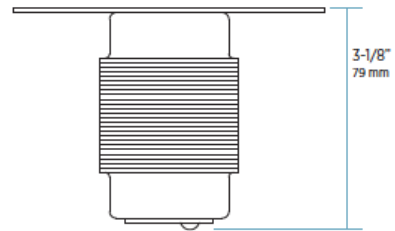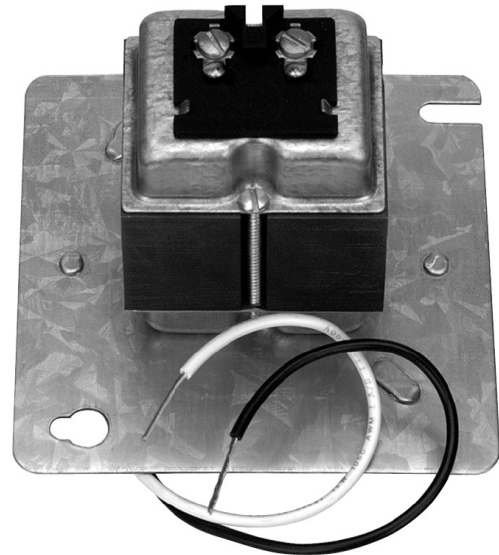

This space for Architect/Engineer Approval